



جامعة الأمير سطام بن عبدالعزيز
Prince Sattam Bin Abdulaziz University

Installation details

Model:  Vulcan S250

Location: Prince Sattam bin Abdulaziz University

Al Kharj, Saudi Arabia

www.psau.edu.sa

Installed by: Wrood Al Shame for Trading & Contracting Est.




Step 1

First, wind plastic foil around the pipe to protect the impulse bands against condensation on the pipe.



Step 2

Wrap the impulse bands around the plastic foil.

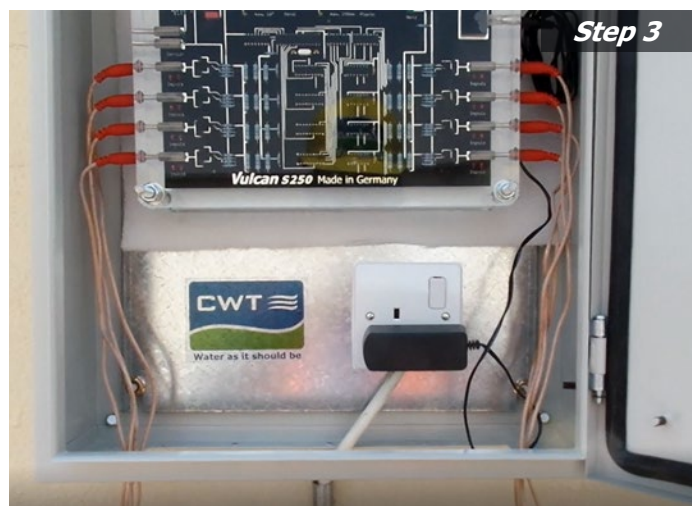


Step 3

Connect the Vulcan S250 unit with the impulse bands. (Vulcan unit was installed in the outdoor case to prevent from humidity.)



Step 4

Check the functionality of Vulcan with a impulse detector.

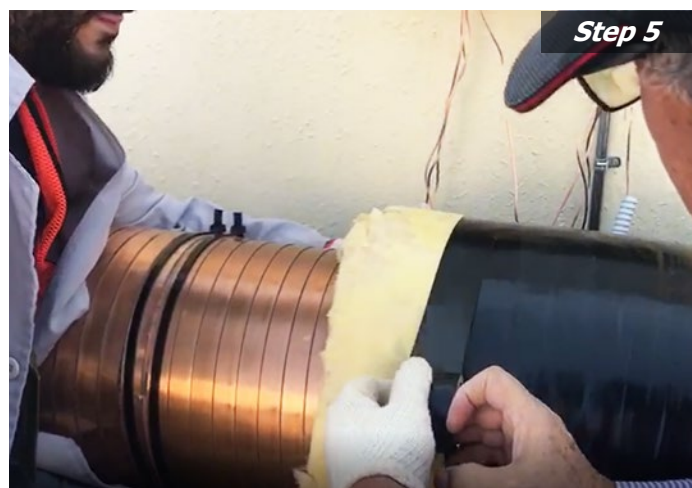

Step 5

To finish, install an insulation protection to cover the impulse bands completely against the elements.